



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.miamidade.gov/buildingcode**

NOTICE OF ACCEPTANCE (NOA)

**T.M. Window & Door Co.
601 N.W. 12th Ave.
Pompano Beach, FL 33069**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "350" Aluminum Sliding Glass Door (Reinforced) – LMI

APPROVAL DOCUMENT: Drawing No. **W02-87**, titled "Series-350 Aluminum Sliding Glass Door (LMI)", sheets 1 through 10 of 10, prepared by Al Farooq Corporation, dated 09/25/02 with last revision on September 16, 2008, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

Limitation:

- 1. See sheet 6 for exterior (positive) pressure water rating Vs sill height.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 07-1009.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 08-0617.03
Expiration Date: January 23, 2013
Approval Date: October 16, 2008
Page 1**

9/24/08

T.M. Window & Door Co.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # 07-1009.03)

1. Manufacturer's die drawings and sections.
2. Drawing No. **W02-87**, titled "Series-350 Aluminum Sliding Glass Door (LMI)", sheets 1 through 10 of 10, prepared by Al Farooq Corporation, dated 09/25/02 with last revision on September 16, 2008, signed and sealed by Dr. Humayoun Farooq, P.E

B. TEST


1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
Along with installation diagram prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5438** dated 12/13/07, signed and sealed by Carlos S. Rionda, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
Along with installation diagram prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3088** dated 11/19/01 and **FTL-3188** dated 03/23/01, both signed and sealed by Luis Figueredo, P.E. (transferred from file # 07-1009.03)
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
Along with installation diagram prepared by Fenestration Testing Laboratory, Inc., Test Report No(s) **FTL-2771** dated 01/15/01 and **FTL-2976** dated 03/02/01, both signed and sealed by Antonio Acevedo, P.E. (transferred from file # 07-1009.03)

C. CALCULATIONS

1. Anchor calculations and structural analysis, complying with FBC, prepared by Al-Farooq Corporation, dated 05/27/08 and last revised on 09/03/08, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Glazing complies with ASTM E1300- 02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).



Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 08-0617.03

Expiration Date: January 23, 2013

Approval Date: October 16, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **03-0415.13** issued to Solutia, Inc. for “**Vanceva™ Composite interlayer**”, expiring on December 11, 2008.
2. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours & CO., Inc. for “**DuPont Sentry Glass Plus**”, expiring on January 14, 2012.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, prepared by Al Farooq Corporation, dated 05/01/08 & 04-14-08 respectively, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Statement letter of compliance, part of above referenced test reports.

G. OTHER

1. This NOA revises NOA # **07-1009.03**, expiring Jan 23, 2013
2. Test proposal dated 01/20/05 approved by BCCO.

Ishaq I. Chanda



Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 08-0617.03

Expiration Date: January 23, 2013

Approval Date: October 16, 2008

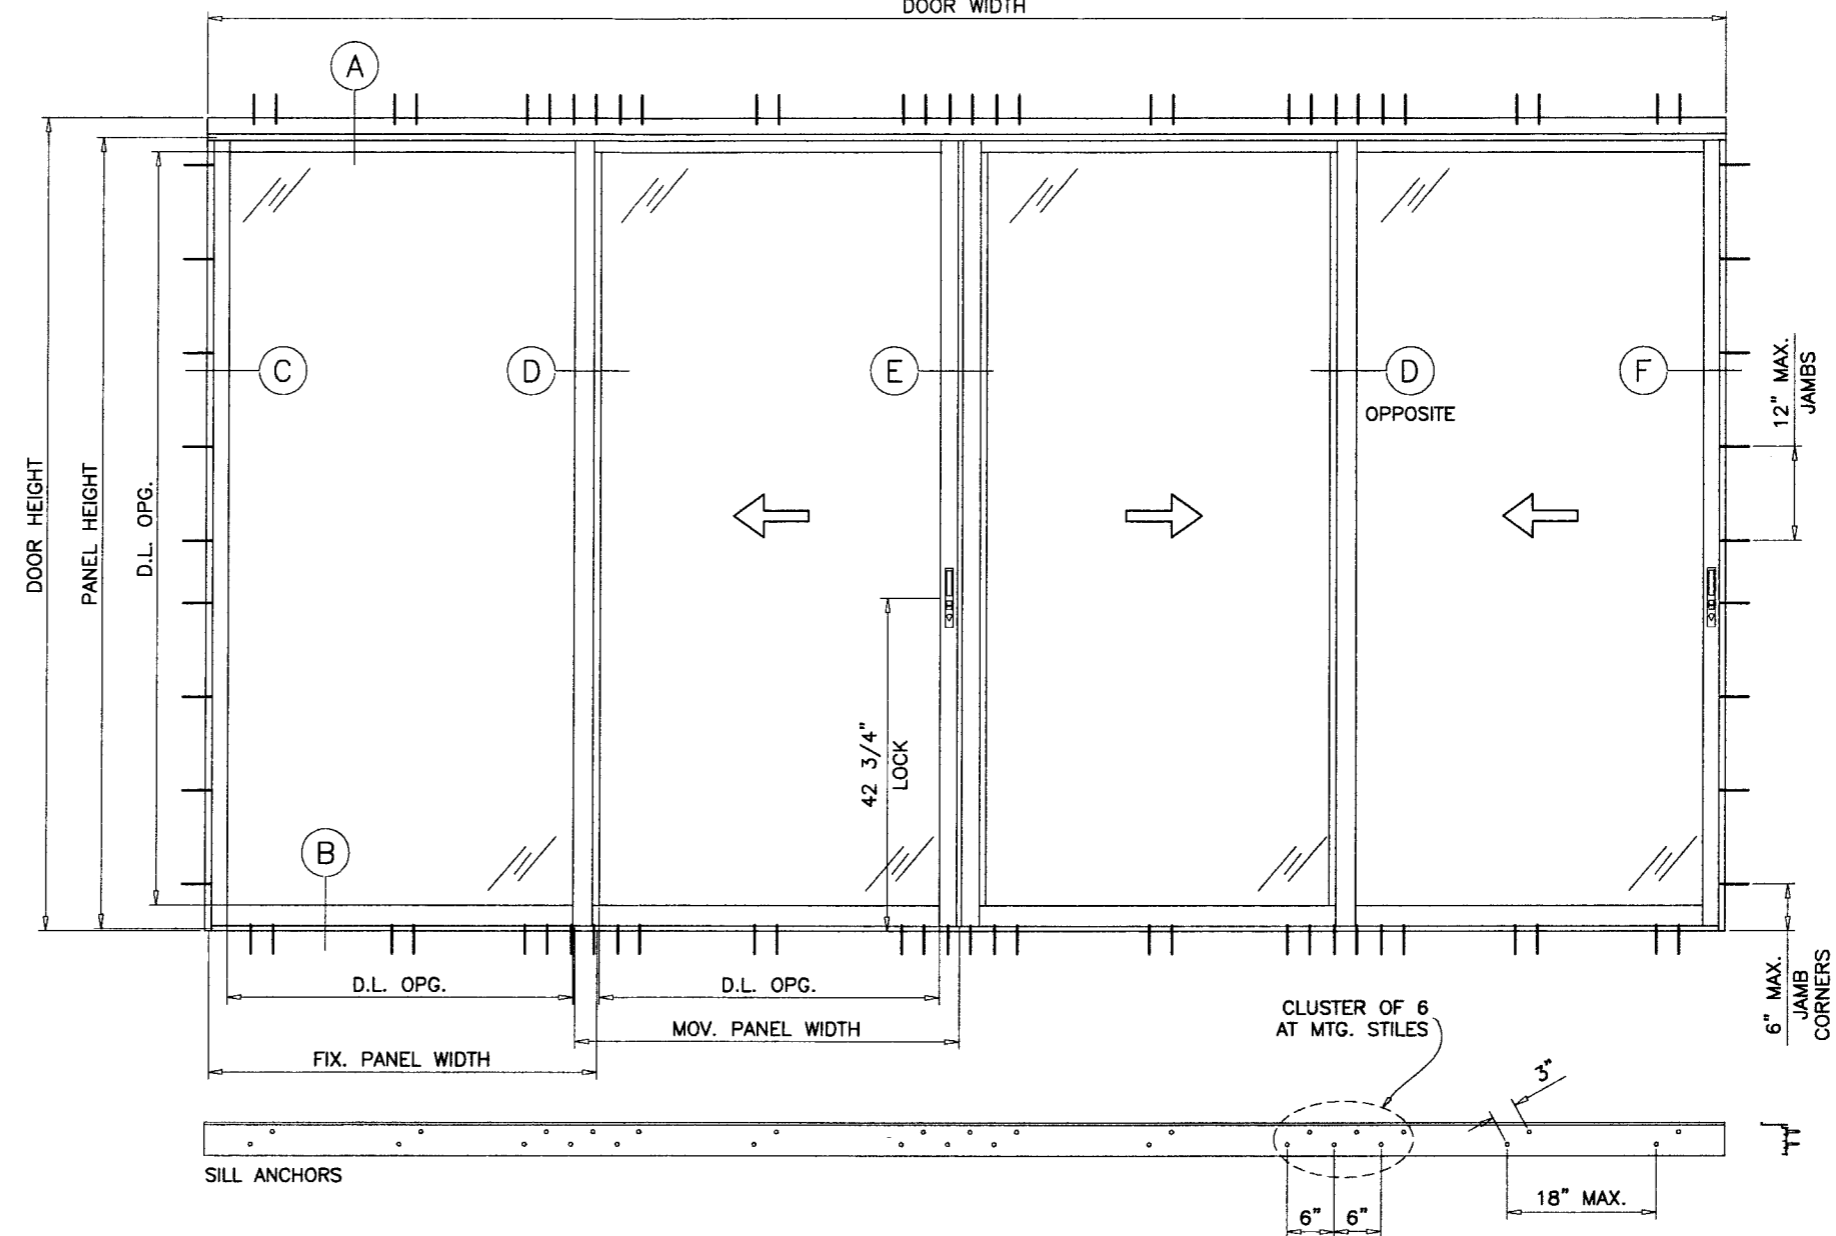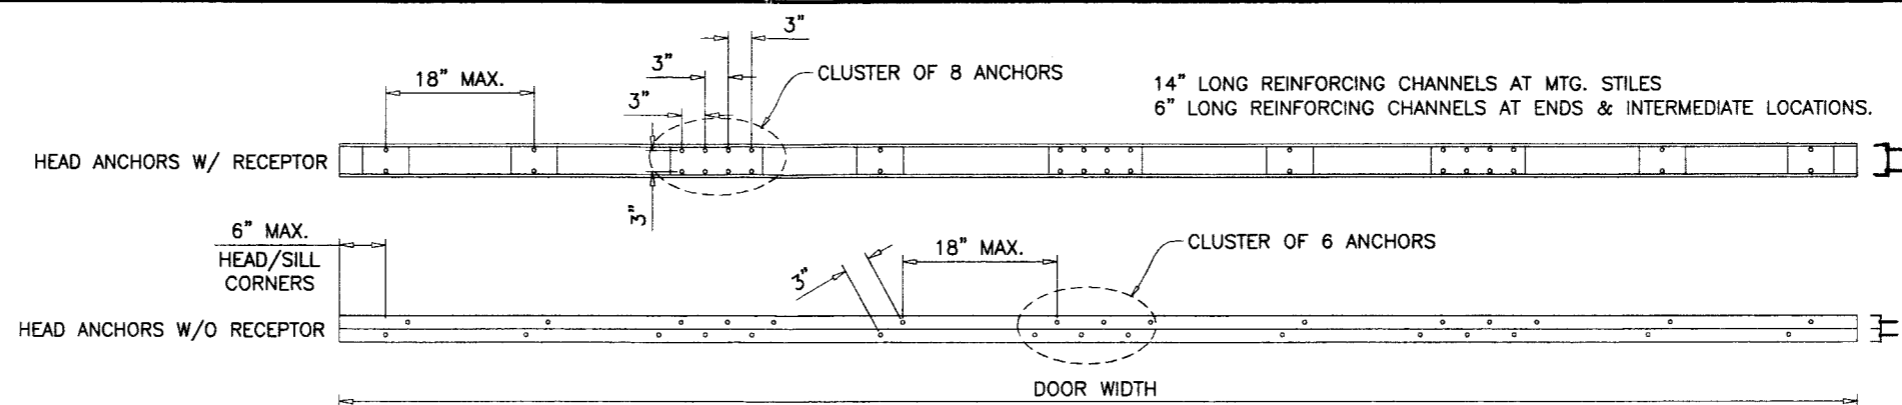

TYPICAL ELEVATION

DAYLITE OPENINGS:
 D.L.O. HEIGHT = DOOR HEIGHT - 7.125"
 D.L.O. WIDTH (FIX. PANEL) = PANEL WIDTH - 5.575"
 D.L.O. WIDTH (OPER. PANEL) = PANEL WIDTH - 5.675"

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 05-0617.03
 Expiration Date Jan 23, 2013
 By: Ishag I. Chanda
 Miami Dade Product Control
 Division

DOORS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

SERIES-350 ALUM. SLIDING GLASS DOOR

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHARTS SHOWN ON SHEETS 3 & 4.

APPLICABLE EGRESS REQUIREMENTS PER FBC TO BE REVIEWED BY BUILDING OFFICIAL.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004/2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-87TMW


SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)

TM WINDOW AND DOOR
 601 N.W. 12TH AVE.
 POMPANO BEACH, FL. 33069
 TEL. (954) 781-4430 FAX. (954) 781-5078


no	date	description
A	08.01.05	UPDATED FOR 2004 FBC
B	04.15.08	GENERAL REVISION
C	08.28.08	REV. PER BCCO COMMENTS
D	09.12.08	REV. PER BCCO COMMENTS

date: 09-25-02
 scale: 1/2" = 1'-0"
 dr. by: HAMID
 chk. by:


drawing no.
W02-87
 sheet 1 of 10




OX (SHOWN)
XO




XX

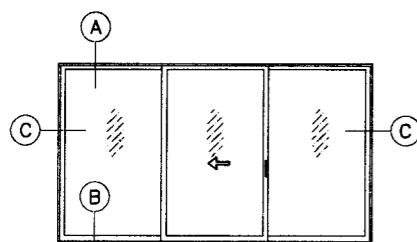






OXO

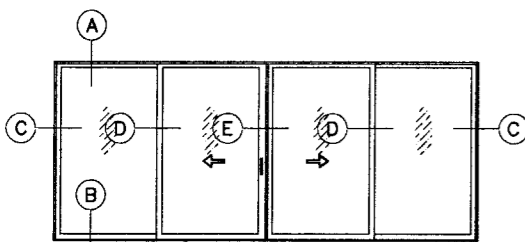

OXXO

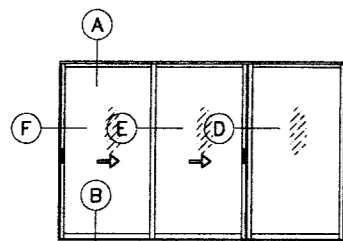

XXO (SHOWN)
OXX

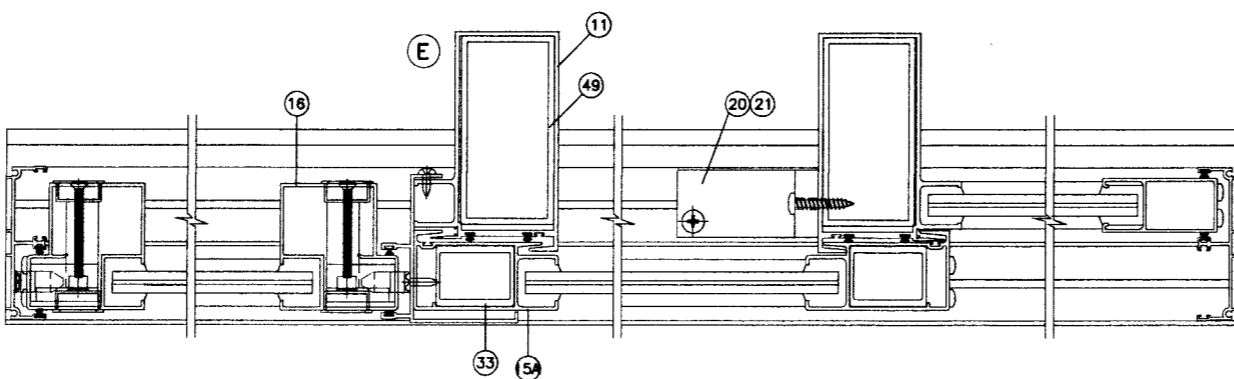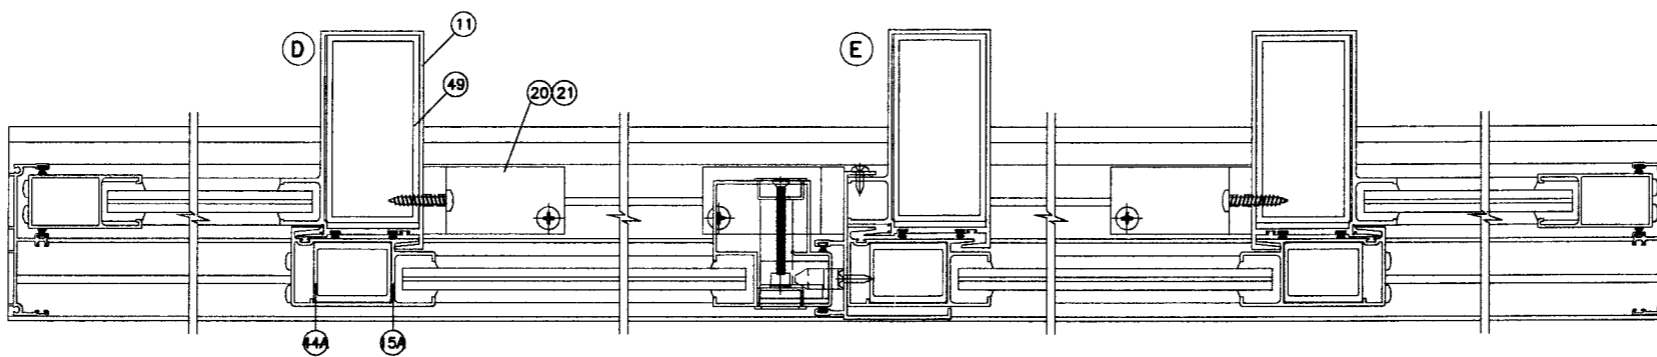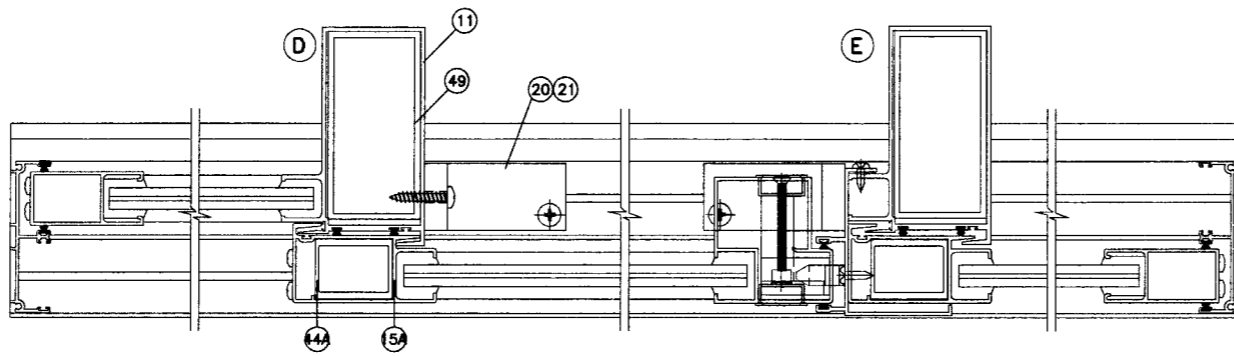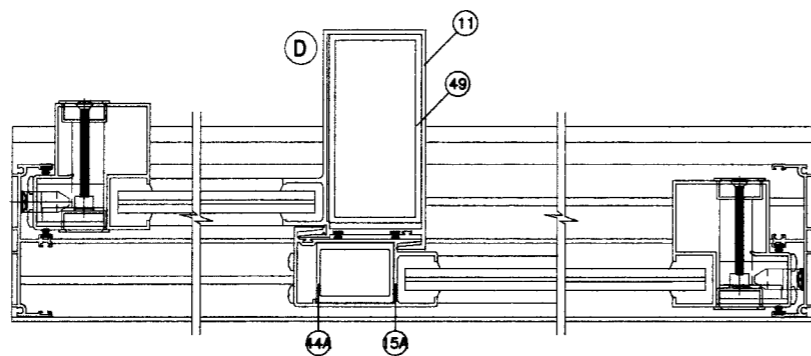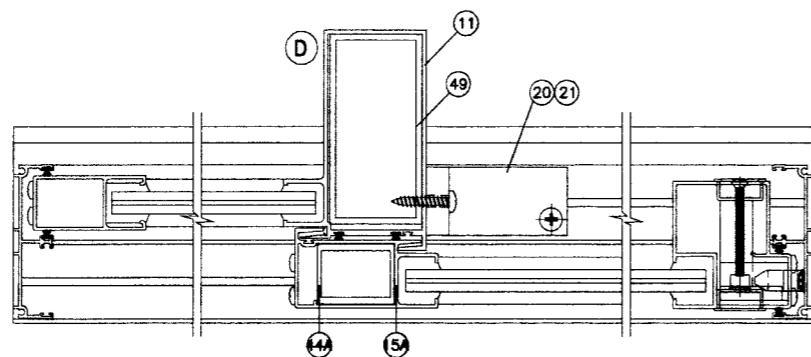

NOTE:
HEAVY REINFORCING IS SHOWN
REFER TO SHEETS 5 & 6 FOR
LIGHT, MEDIUM OR HEAVY REINFORCING
AS APPLICABLE PER DESIGN PRESSURE CHART.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-0617-03
Expiration Date JAN 23, 2013
By Ismael Chande
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W02-87TMW

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		REV. PER BCCO COMMENTS

date: 09-25-02
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
SEP 15 2008

drawing no.
W02-87
sheet 2 of 10


APPROVED CONFIGURATIONS

DESIGN LOAD CAPACITY - PSF DOORS W/O HEAD RECEPTOR							
LIGHT REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'F'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	80	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	75.0	75.0	75.0	75.0	75.0
42		75.0	71.4	75.0	71.4	75.0	71.4
48		75.0	65.8	75.0	65.8	75.0	65.8
54	75.0	61.8	75.0	61.8	75.0	61.8	
24	84	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	74.5	75.0	74.5	75.0	74.5
42		75.0	66.9	75.0	66.9	75.0	66.9
48		75.0	61.5	75.0	61.5	75.0	61.5
54	74.8	57.5	74.8	57.5	74.8	57.5	
24	90	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	68.3	75.0	68.3	75.0	68.3
42		75.0	61.1	75.0	61.1	75.0	61.1
48		72.6	55.9	72.6	55.9	72.6	55.9
24	96	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	72.8	75.0	72.8	75.0	72.8
36		75.0	63.0	75.0	63.0	75.0	63.0
42		73.0	56.2	73.0	56.2	73.0	56.2
48		66.6	51.2	66.6	51.2	66.6	51.2
24	96-1/2	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	72.4	75.0	72.4	75.0	72.4
36		75.0	62.6	75.0	62.6	75.0	62.6
42		72.6	55.8	72.6	55.8	72.6	55.8
48		66.1	50.9	66.1	50.9	66.1	50.9


DESIGN LOAD CAPACITY - PSF DOORS W/O HEAD RECEPTOR							
MEDIUM REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'F'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	84	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54		100.0	120.0	100.0	120.0	100.0	120.0
24	90	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54		100.0	120.0	100.0	120.0	100.0	120.0
24	96	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	119.0	100.0	119.0	100.0	119.0
54		100.0	110.3	100.0	110.3	100.0	110.3
24	102	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	109.8	100.0	109.8	100.0	109.8
54		100.0	103.7	100.0	103.7	100.0	103.7
24	108	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	112.2	100.0	112.2	100.0	112.2
48		100.0	101.7	100.0	101.7	100.0	101.7
54		100.0	101.7	100.0	101.7	100.0	101.7

DESIGN LOAD CAPACITY - PSF DOORS W/O HEAD RECEPTOR							
HEAVY REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'F'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	84	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54		100.0	120.0	100.0	120.0	100.0	120.0
24	90	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54		100.0	120.0	100.0	120.0	100.0	120.0
24	96	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	112.7	100.0	112.7	100.0	112.7
54		100.0	106.0	100.0	106.0	100.0	106.0
24	102	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	112.2	100.0	112.2	100.0	112.2
54		100.0	103.7	100.0	103.7	100.0	103.7
24	108	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	114.9	100.0	114.9	100.0	114.9
48		100.0	104.1	100.0	104.1	100.0	104.1
54		96.0	96.0	100.0	96.0	100.0	96.0
24	114	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	107.5	100.0	107.5	100.0	107.5
48		97.2	97.2	100.0	97.2	100.0	97.2
54		100.0	120.0	100.0	120.0	100.0	120.0
24	120	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	113.5	100.0	113.5	100.0	113.5
42		100.0	100.2	100.0	100.2	100.0	100.2
48		90.4	90.4	100.0	90.4	100.0	90.4
54		100.0	120.0	100.0	120.0	100.0	120.0

GLASS TYPES A OR B ARE APPLICABLE TO CHARTS

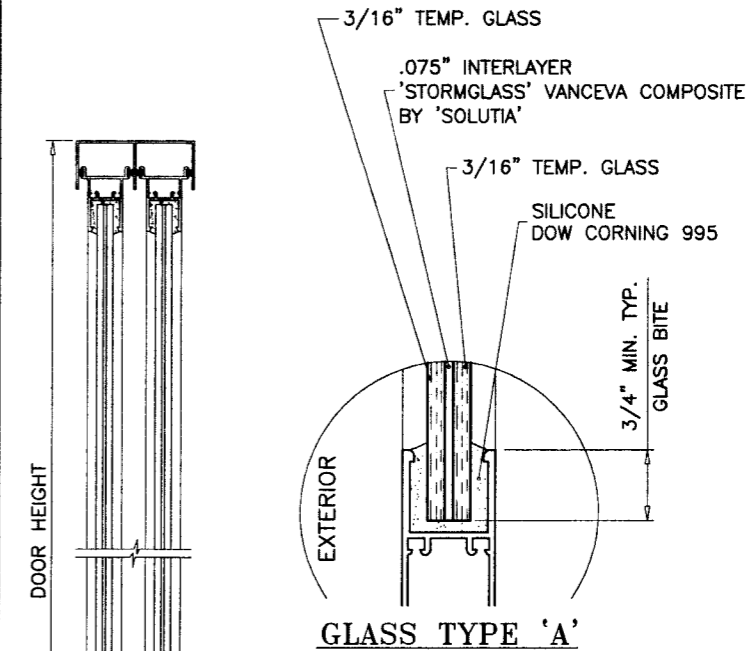

GLASS TYPE 'A'

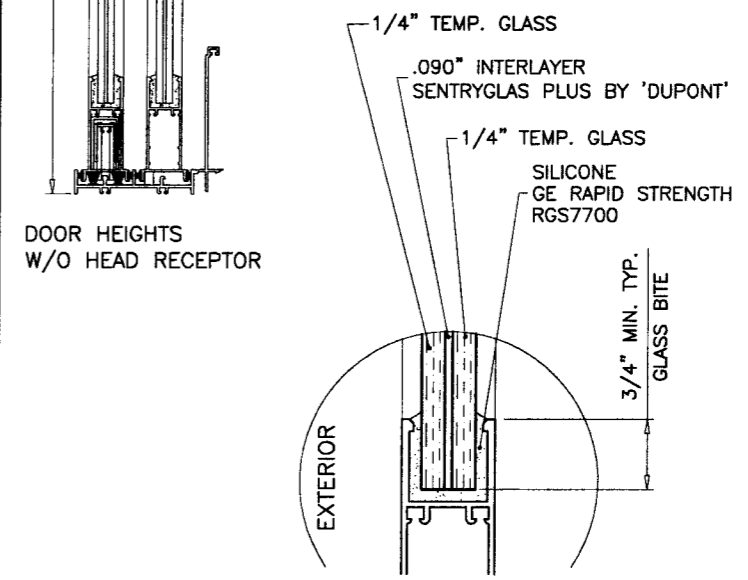

GLASS TYPE 'B'

GLAZING OPTIONS

DOOR HEIGHTS W/O HEAD RECEPTOR

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' 1/4" TAPCONS BY 'ELCO'

THRU 1BY OR 2BY WOOD BUCKS INTO MASONRY OR CONC.
1-3/4" MIN. EMBED INTO GROUT FILLED MASONRY OR CONC.

TYPE 'B' 1/4" TAPCONS BY 'ELCO'

DIRECTLY INTO MASONRY OR CONC.
1-3/4" MIN. EMBED INTO GROUT FILLED MASONRY OR CONC.

TYPE 'F' #14 SMS OR SELF DRILLING SCREWS

INTO APPROVED MULLIONS OR METAL STRUCTURES
STEEL : 1/8" MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

DOORS W/O HEAD RECEPTOR

CLUSTER OF 6 ANCHORS AT STILE ENDS AT HEAD & SILL

ALL EXTERIOR(+) LOADS SHOWN ON THIS SHEET ARE FOR DOORS USING FRAME SILL '4A' & '4B' FOR DOORS USING FRAME SILL '4' LIMIT EXT.(+) LOADS TO 90.0 PSF.

NOTE:
GLASS CAPACITIES ARE BASED ON ASTM E1300-02/04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-0617.03
Expiration Date JAN 23, 2013

By Ishaq I. Chaudhry
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TAW

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078

no.	date	description
A	08.01.05	GLASS TYPE 'E' ADDED
B	04.15.08	GENERAL REVISION
C	08.28.08	REV. PER BCCO COMMENTS
D	09.12.08	NO CHANGE THIS SHEET


date: 09-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W02-87
sheet 3 of 10

DESIGN LOAD CAPACITY - PSF DOORS WITH HEAD RECEPTOR							
LIGHT REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'C'		ANCHORS TYPE 'D'		ANCHORS TYPE 'E'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	80	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	75.0	75.0	75.0	75.0	75.0
42		75.0	71.4	75.0	71.4	75.0	71.4
48		75.0	65.8	75.0	65.8	75.0	65.8
54	75.0	61.8	75.0	61.8	75.0	61.8	
24	84	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	74.5	75.0	74.5	75.0	74.5
42		75.0	66.9	75.0	66.9	75.0	66.9
48		75.0	61.5	75.0	61.5	75.0	61.5
54	74.8	57.5	74.8	57.5	74.8	57.5	
24	90	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	75.0	75.0	75.0	75.0	75.0
36		75.0	68.3	75.0	68.3	75.0	68.3
42		75.0	61.1	75.0	61.1	75.0	61.1
48		72.6	55.9	72.6	55.9	72.6	55.9
24	96	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	72.8	75.0	72.8	75.0	72.8
36		75.0	63.0	75.0	63.0	75.0	63.0
42		73.0	56.2	73.0	56.2	73.0	56.2
48		66.6	51.2	66.6	51.2	66.6	51.2
24	96-1/2	75.0	75.0	75.0	75.0	75.0	75.0
30		75.0	72.4	75.0	72.4	75.0	72.4
36		75.0	62.6	75.0	62.6	75.0	62.6
42		72.6	55.8	72.6	55.8	72.6	55.8
48		66.1	50.9	66.1	50.9	66.1	50.9

DESIGN LOAD CAPACITY - PSF DOORS WITH HEAD RECEPTOR							
MEDIUM REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'C'		ANCHORS TYPE 'D'		ANCHORS TYPE 'E'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	84	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	90	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
24	96	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	119.0	100.0	119.0	100.0	119.0
48		100.0	110.3	100.0	110.3	100.0	110.3
24	102	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	109.8	100.0	109.8	100.0	109.8
24	108	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	112.2	100.0	112.2	100.0	112.2
48		100.0	101.7	100.0	101.7	100.0	101.7

DESIGN LOAD CAPACITY - PSF DOORS WITH HEAD RECEPTOR							
HEAVY REINFORCING SEE SHEET 5 FOR DETAILS							
PANEL WIDTH INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'C'		ANCHORS TYPE 'D'		ANCHORS TYPE 'E'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	84	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	90	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	96	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	102	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	108	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	114	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	120.0	100.0	120.0	100.0	120.0
54	100.0	120.0	100.0	120.0	100.0	120.0	
60	100.0	120.0	100.0	120.0	100.0	120.0	
24	120	100.0	120.0	100.0	120.0	100.0	120.0
30		100.0	120.0	100.0	120.0	100.0	120.0
36		100.0	120.0	100.0	120.0	100.0	120.0
42		100.0	120.0	100.0	120.0	100.0	120.0
48		100.0	115.8	100.0	120.0	100.0	120.0

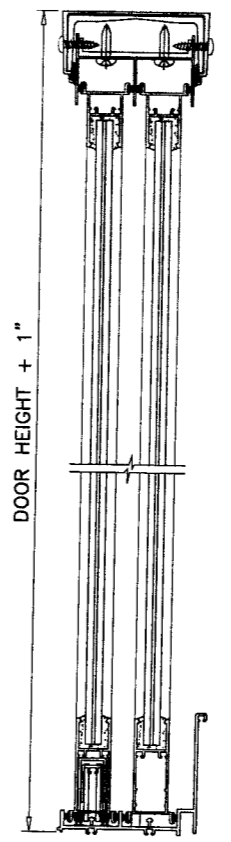

CHARTS AT LEFT ARE FOR DOOR HEIGHTS WITHOUT HEAD RECEPTOR. DOORS USING HEAD RECEPTOR MAY BE 1" HIGHER THAN SHOWN (SEE SKETCH)

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

ANCHORS WITH HEAD RECEPTOR

TYPE 'C' 1/4" TAPCONS BY 'ELCO'
THRU 1BY OR 2BY WOOD BUCKS INTO MASONRY OR CONC. 1-3/4" MIN. EMBED INTO GROUT FILLED MASONRY OR CONC.

TYPE 'D' 1/4" TAPCONS BY 'ELCO'
DIRECTLY INTO MASONRY OR CONC. 1-3/4" MIN. EMBED INTO GROUT FILLED MASONRY OR CONC.

TYPE 'E' #14 SMS OR SELF DRILLING SCREWS
INTO APPROVED MULLIONS OR METAL STRUCTURES
STEEL : 1/8" MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

EDGE DISTANCES
INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

DOORS WITH HEAD RECEPTOR
CLUSTER OF 8 ANCHORS AT STILE ENDS AT HEAD
CLUSTER OF 6 ANCHORS AT STILE ENDS AT SILL

ALL EXTERIOR(+) LOADS SHOWN ON THIS SHEET ARE FOR DOORS USING FRAME SILL '4A' & '4B' FOR DOORS USING FRAME SILL '4' LIMIT EXT.(+) LOADS TO 90.0 PSF.

NOTE:
GLASS CAPACITIES ARE BASED ON ASTM E1300-02/04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 08-0617-03
Expiration Date JAN 23, 2013
By *Shay L. Chaudhry*
Miami Dade Product Control Division

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TAW


SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)

TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078


no	date	by	description
B	04.15.08		GENERAL REVISION
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		NO CHANGE THIS SHEET

date: 09-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no. **W02-87**
sheet 4 of 10

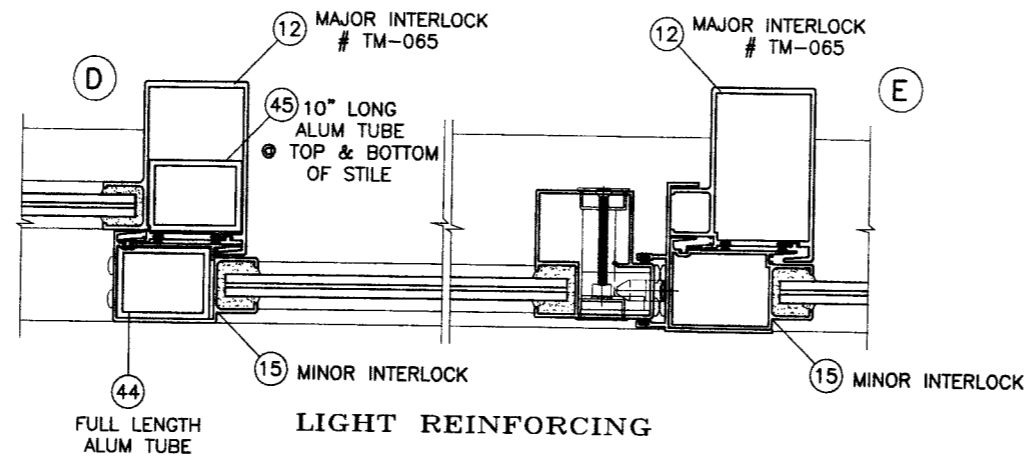

LIGHT REINFORCING

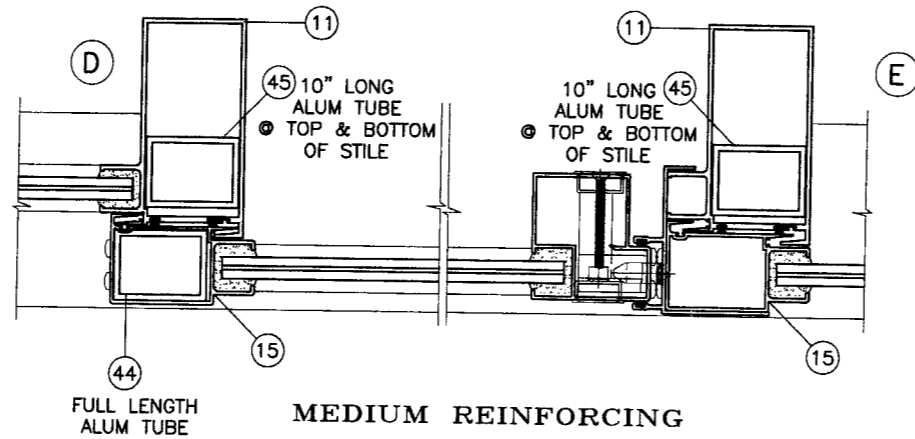

MEDIUM REINFORCING

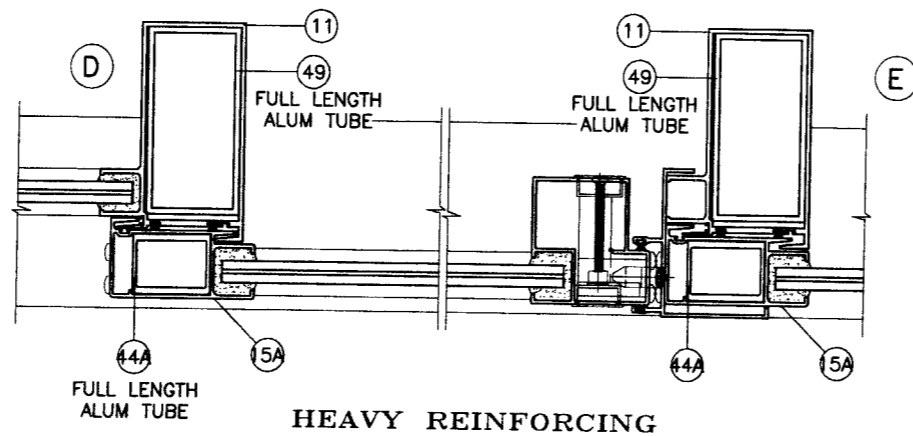

HEAVY REINFORCING

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 18557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 08-0617-03
Expiration Date Jan 23, 2011
By Ishtaq I. Chaudhry
Miami Dade Product Control
Division


SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
A	08.01.05		GLASS TYPE 'E' ADDED
B	04.15.08		GENERAL REVISION
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		NO CHANGE THIS SHEET





date: 09-25-02
scale: 1/4" = 1"
dr. by: HAMID
chk. by:

drawing no.
W02-87
sheet 5 of 10

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TAW

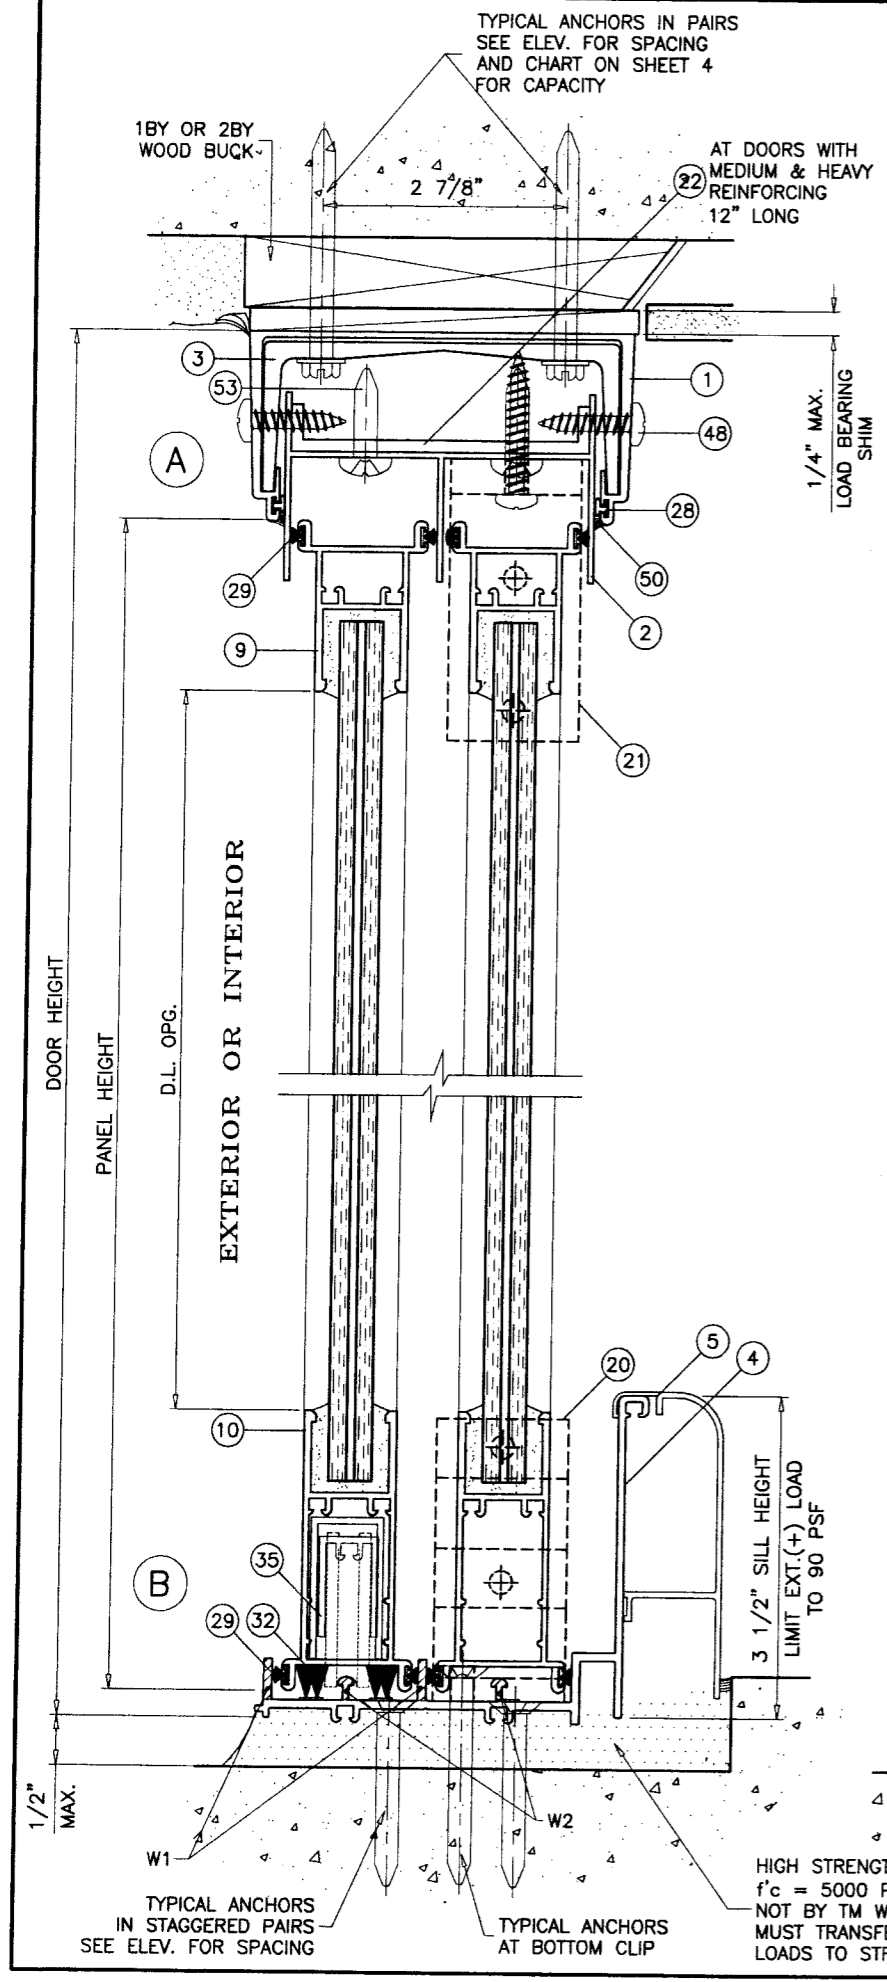

WOOD BUCKS AND METAL STRUCTURE NOT BY TM WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

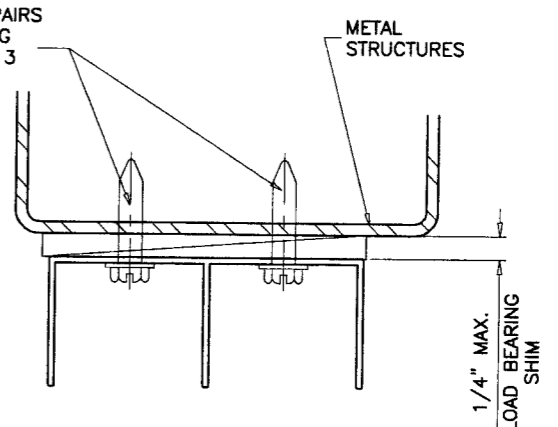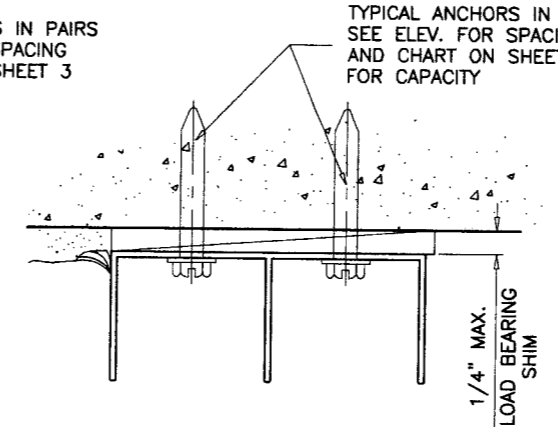
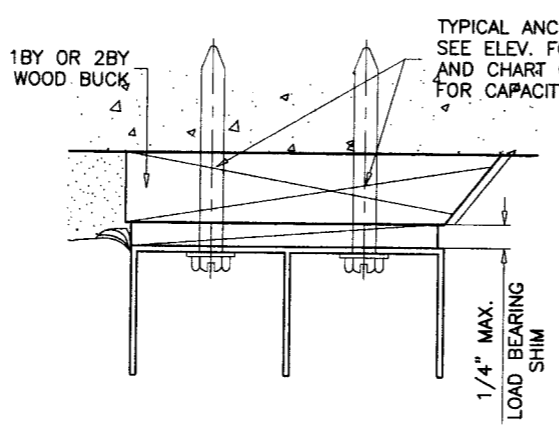
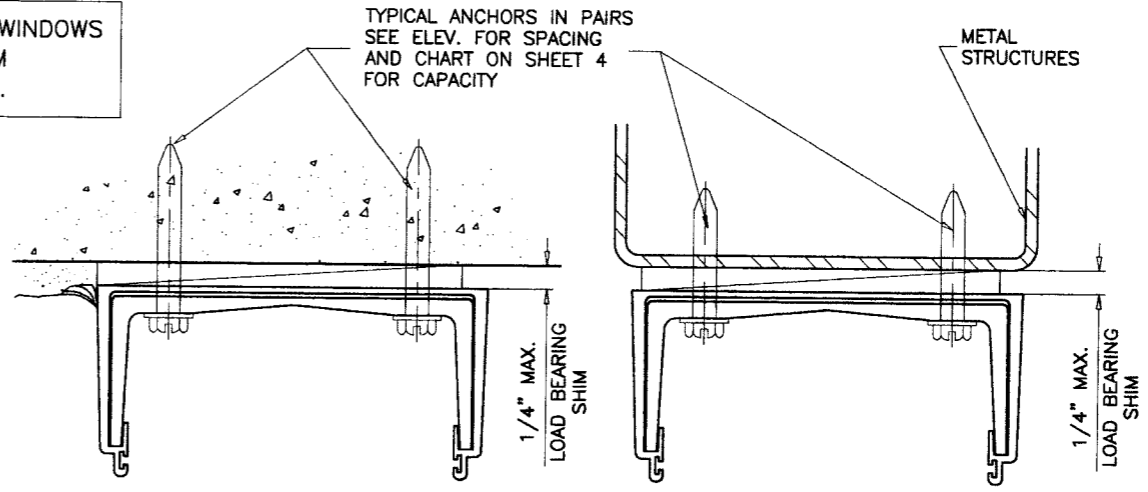


SEALANTS:

FIXED PANEL STILE TO FRAME, PANEL AND FRAME CORNERS AND HEAD RECEPTOR TO FRAME SEALED WITH CLEAR COLORED SILICONE.

WEEPHOLES:

- W1 = (4) 15/16" WEEP NOTCH
ONE AT EACH END OF EACH PANEL
- W2 = (4) 1/4" WEEP NOTCH
ONE AT EACH END OF EACH PANEL

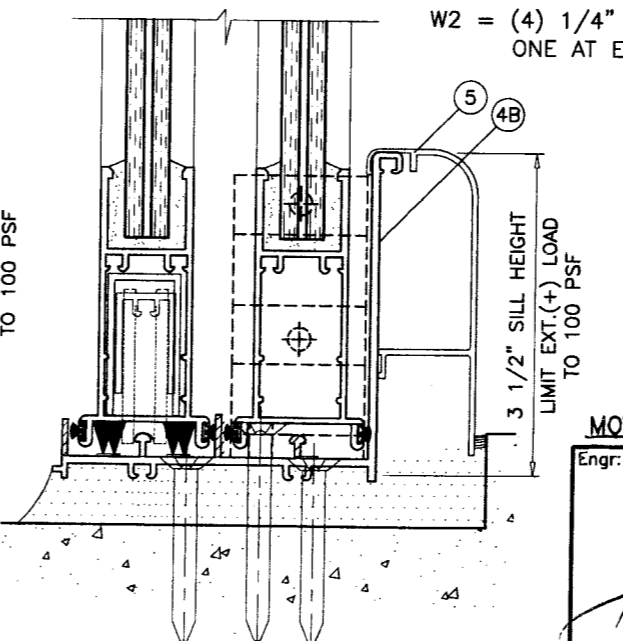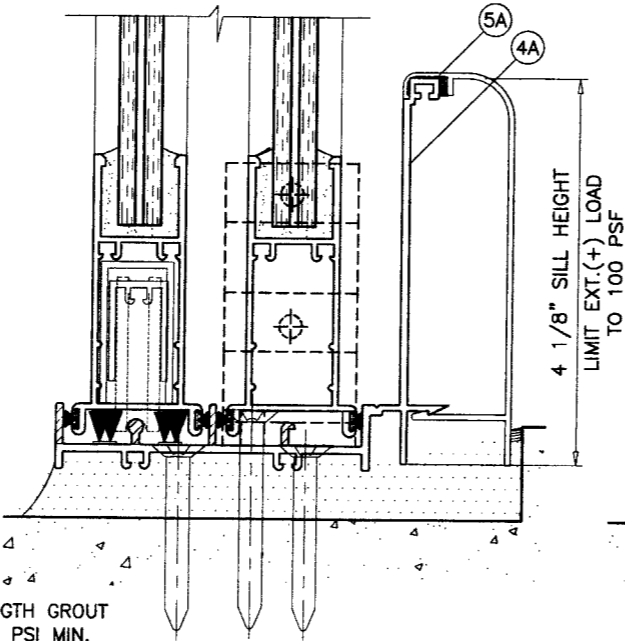

MOV. PANEL BOTTOM RAIL

Engr. DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 08-0617-03
Expiration Date JAN 23 2012
By *Shahid Chaudhry*
Miami Dade Product Control Division


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TMW

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
A	08.01.05		ANCHORS SPACING ADDED
B	04.15.08		GENERAL REVISION
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		NO CHANGE THIS SHEET

date: 09-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:



drawing no.
W02-87
sheet 6 of 10

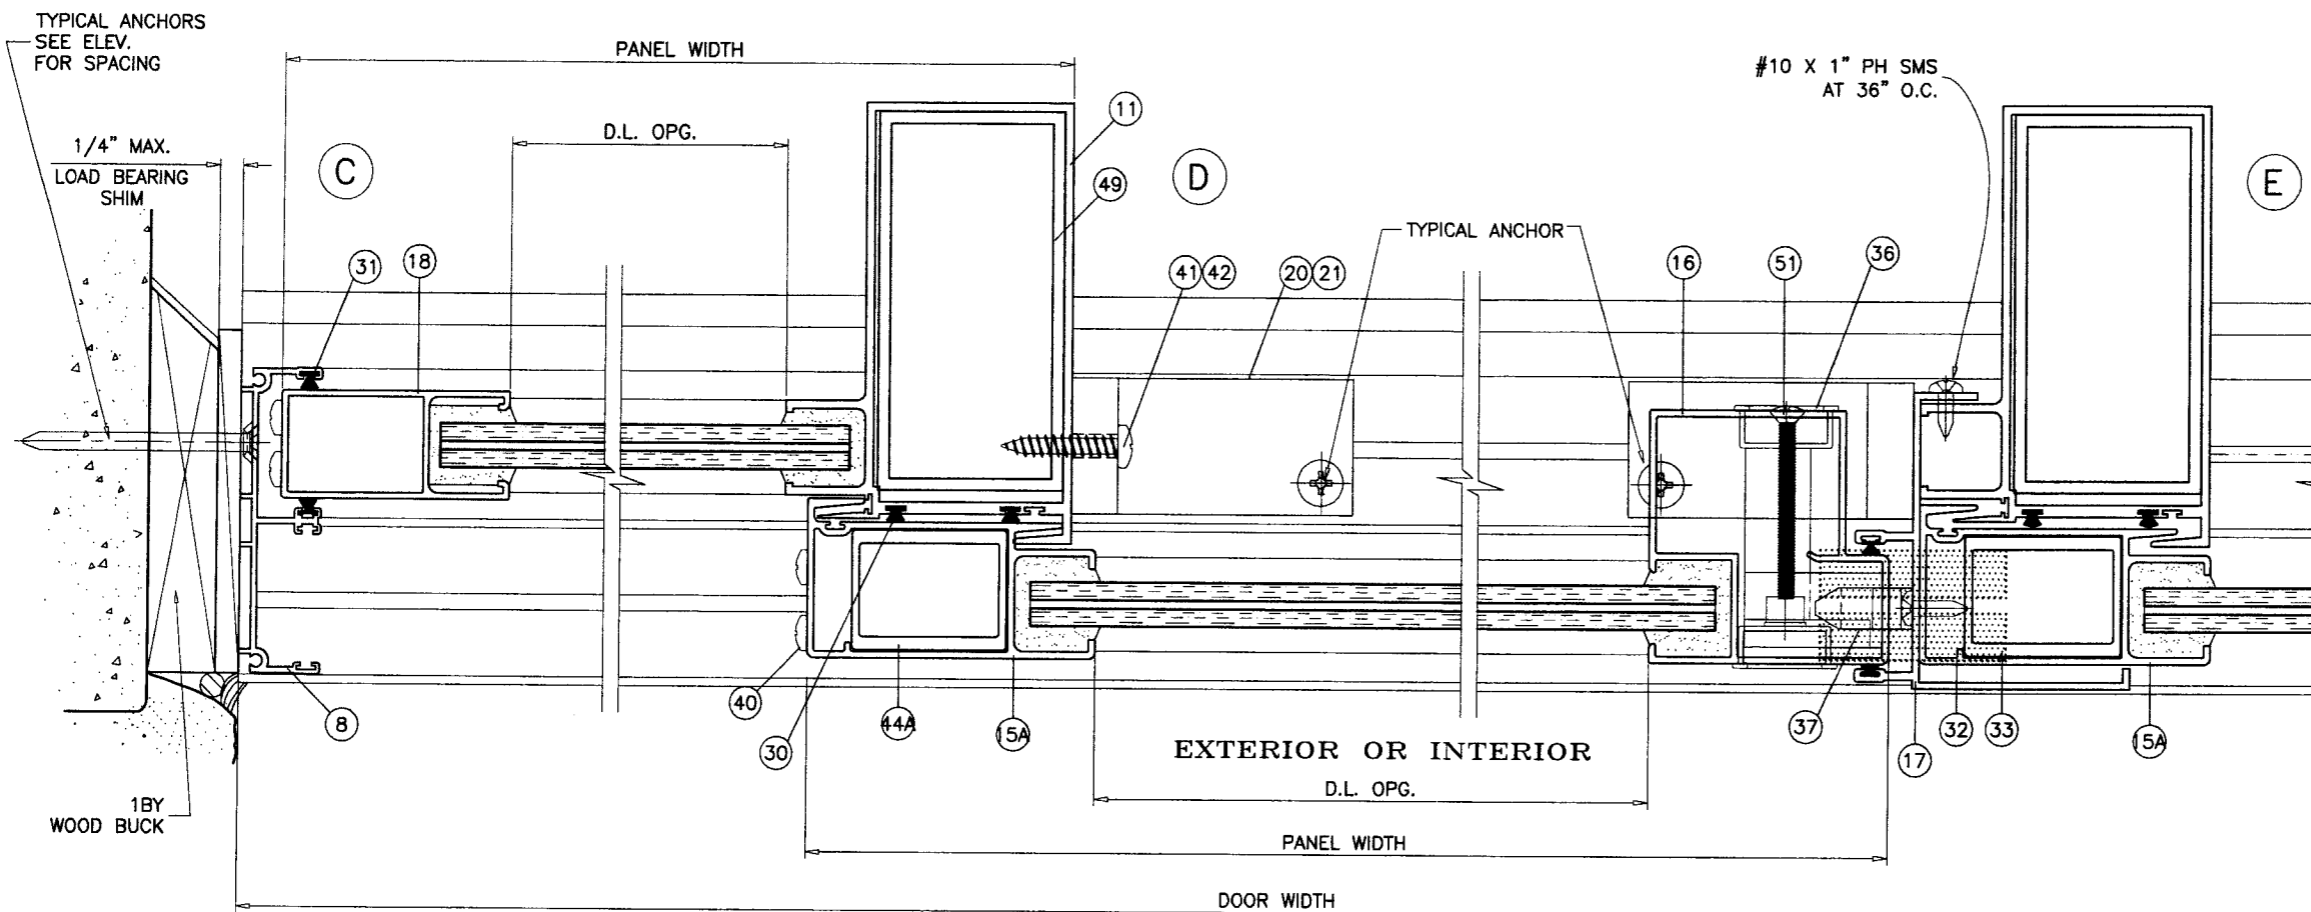


1BY WOOD BUCK

EXTERIOR OR INTERIOR
D.L. OPG.

DOOR WIDTH

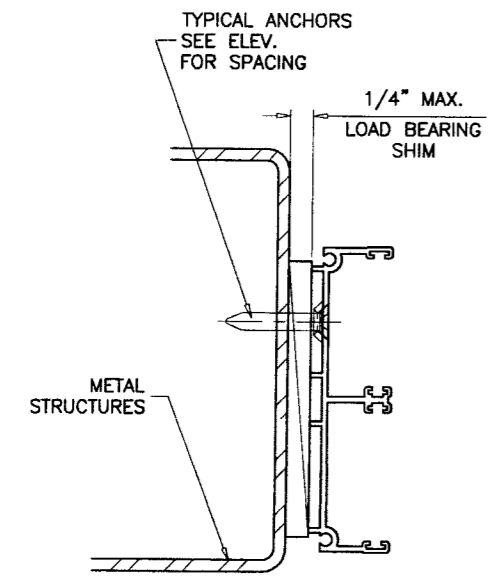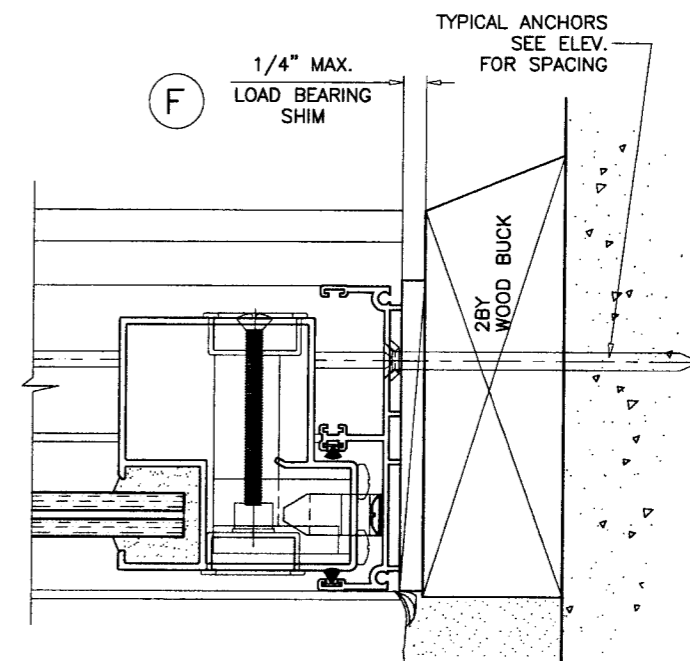

ATTACHMENT TO METAL STRUCTURES
STEEL OR ALUMINUM

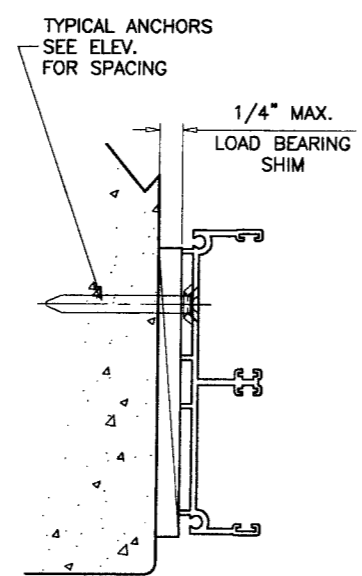

ATTACHMENT TO CONCRETE
OR CONC. BLOCK

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 08-0617-03
Expiration Date JAN 23, 2010
By Ishaq I. Chaudhry
Miami Dade Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W02-87TMM

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078


no	date	by	description
A	08.01.05		NO CHANGE THIS SHEET
B	04.15.08		GENERAL REVISION
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		NO CHANGE THIS SHEET

date: 08-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W02-87
sheet 7 of 10

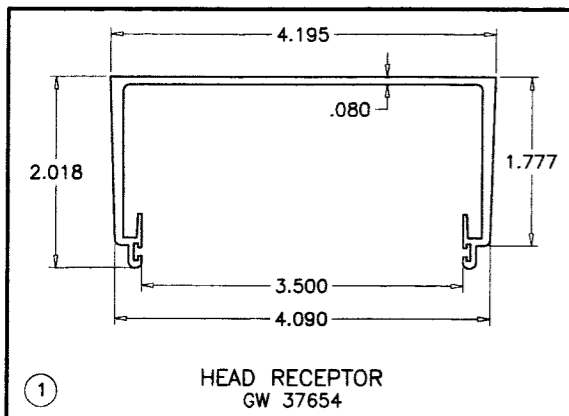


① HEAD RECEPTOR
GW 37654

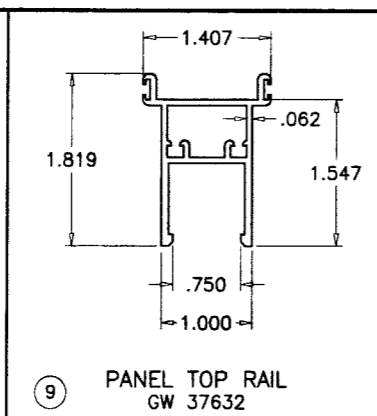


⑨ PANEL TOP RAIL
GW 37632

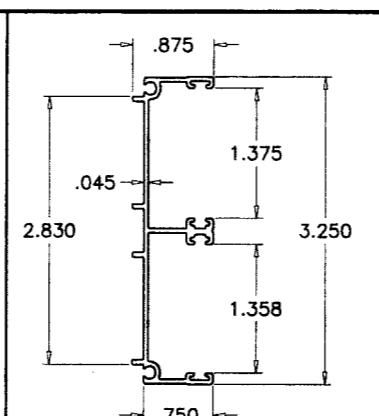


⑧ DOOR FRAME JAMB
GW 34977

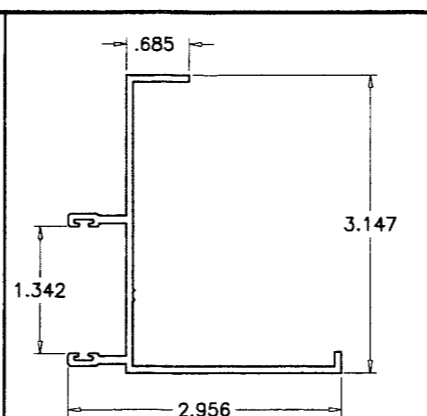


STILE ADAPTER
GW 37629

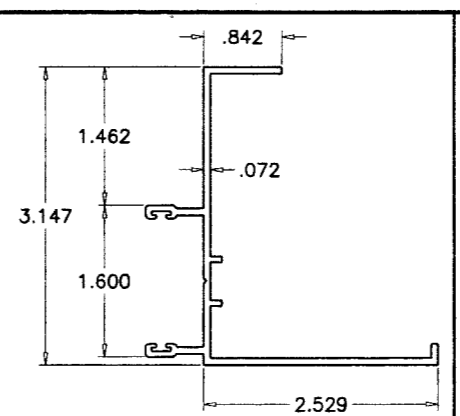


STILE ADAPTER
TM-085A

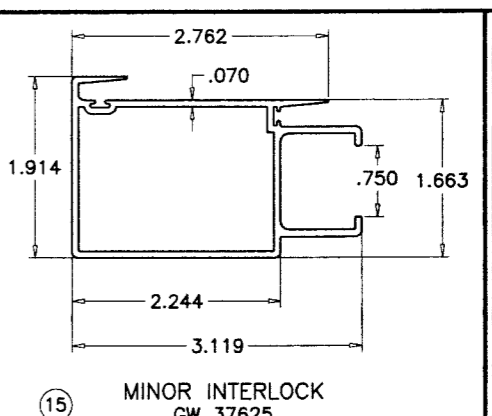


⑮ MINOR INTERLOCK
GW 37625

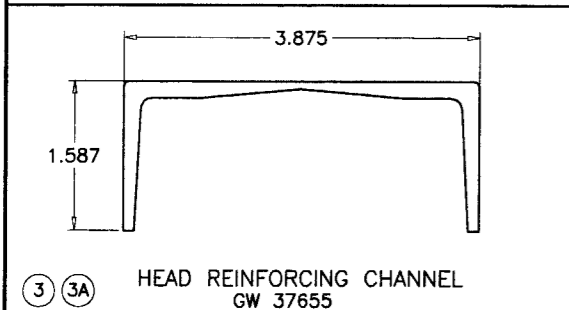


③ 3A HEAD REINFORCING CHANNEL
GW 37655

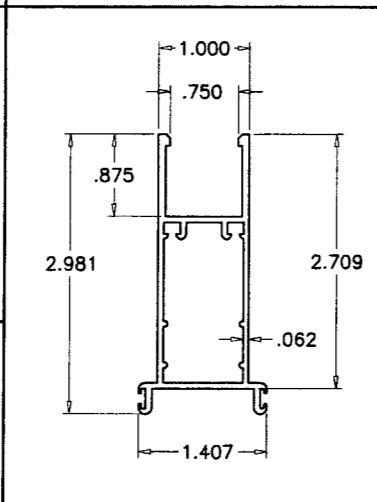


⑩ PANEL BOTTOM RAIL
GW 37624

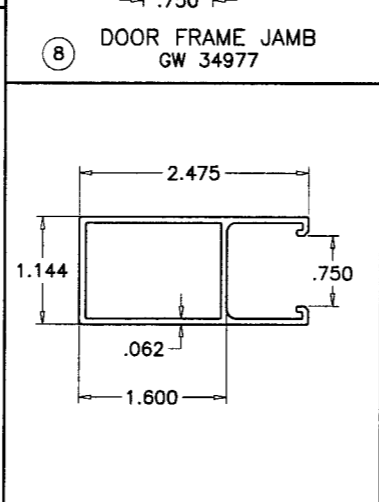


⑱ LOCK STILE
GW 37637

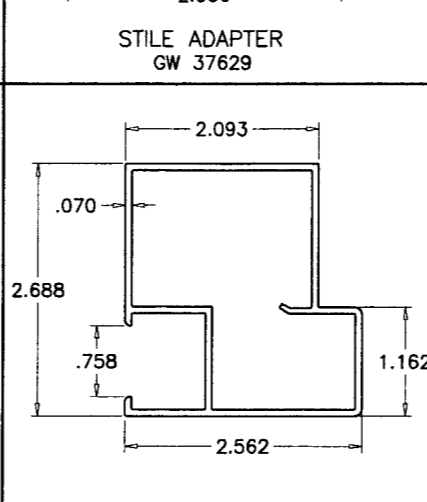


⑯ MALE BUTT STILE
GW 37623

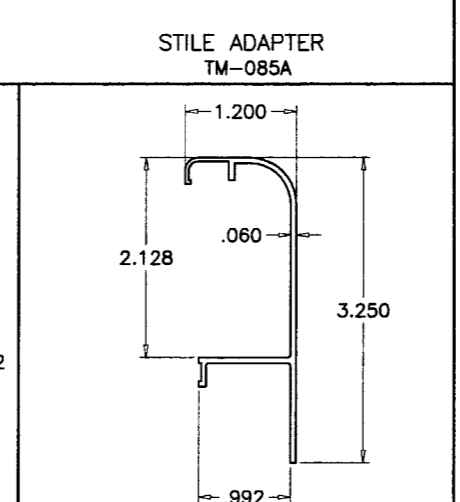


⑤ SILL COVER
TM-095

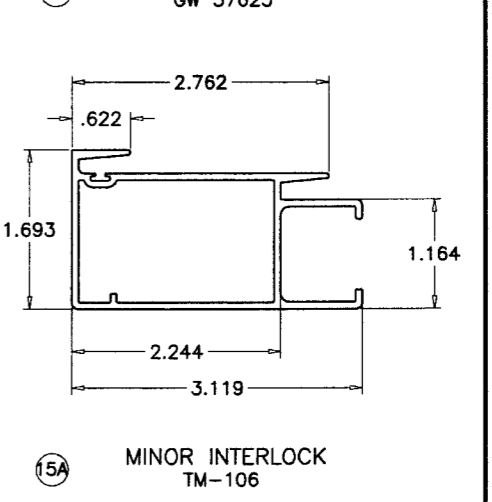


⑮A MINOR INTERLOCK
TM-106

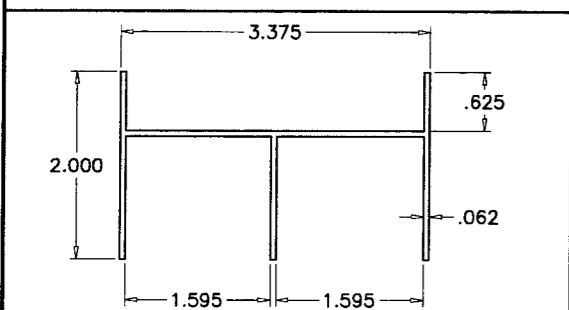


② FRAME HEAD
GW 30710

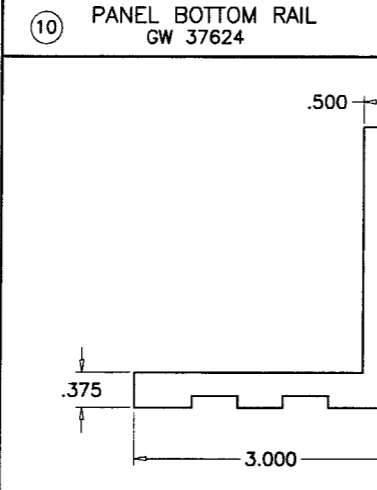


⑳ ㉑ FIX. PANEL CLIP
GW 37743

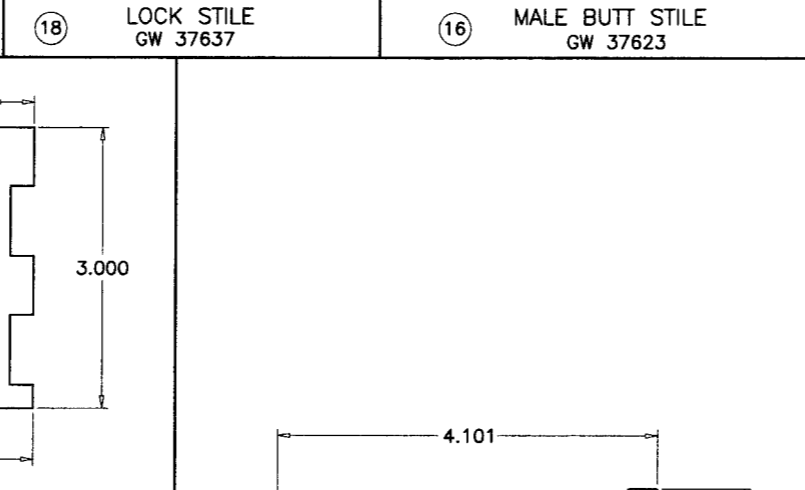


⑤A SILL COVER
TM-074

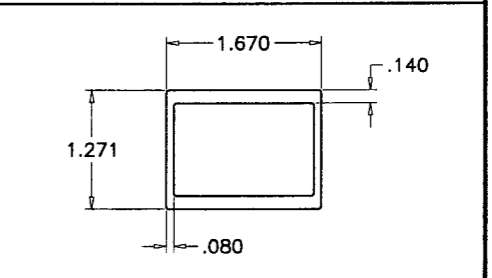


④A MINOR INTERLOCK REINFORCEMENT
TM-107
LENGTH = PANEL HT. - 4.5"

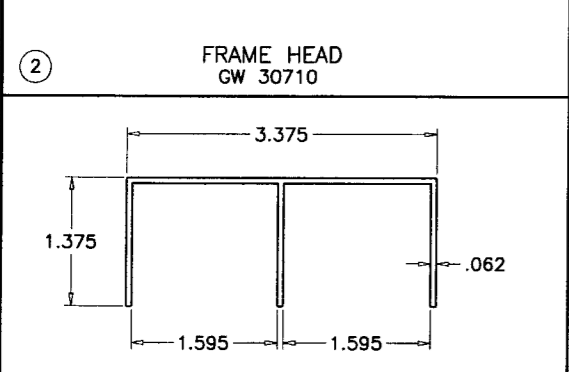


②A FRAME HEAD (OPTIONAL)
GW 32096

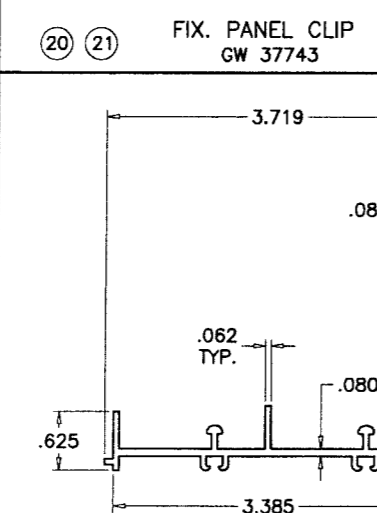

④B FRAME SILL
TM-177

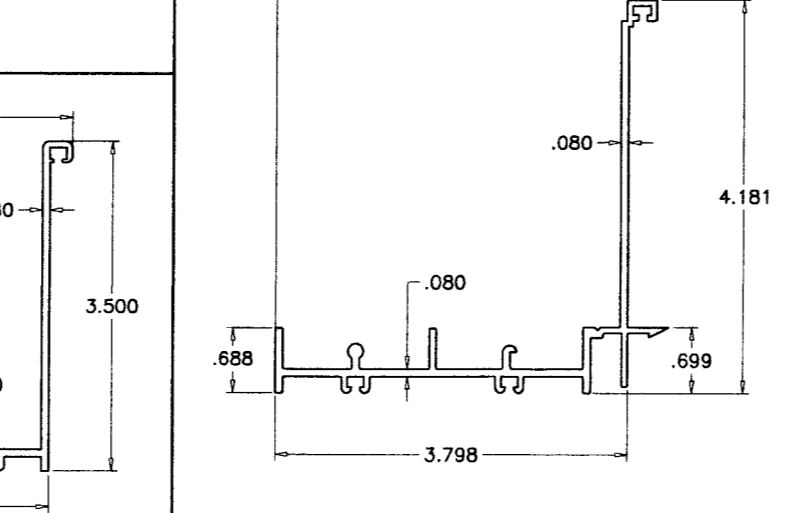

④A FRAME SILL (OPTIONAL)
TM-067

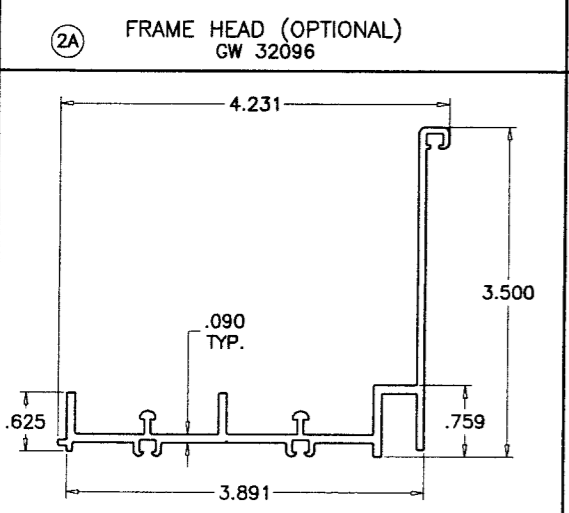

④ FRAME SILL
GW 37557

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 15 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 08-0617.03
Expiration Date JAN 23, 2013
By Ishtaq I. Chaudhry
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TMW


SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	description	NO CHANGE THIS SHEET	GENERAL REVISION	NO CHANGE THIS SHEET	NO CHANGE THIS SHEET
A	08.01.05					
B	04.15.08					
C	08.28.08					
D	09.12.08					


date: 09-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W02-87
sheet 8 of 10


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	GW 37654	1	HEAD RECEPTOR	ALUM-6063 T5	FRAME TOP
2	GW 30710	1	FRAME HEAD	ALUM-6063 T6	FRAME TOP
2A	GW 32096	1	FRAME HEAD (OPTIONAL)	ALUM-6063 T6	FRAME TOP
3	GW 37655	6	HEAD RECEPTOR REINFORCEMENT (6" LONG)	ALUM-6063 T5	AT HEAD ENDS & CENTER LINE OF PANELS
3A	GW 37655	3	HEAD RECEPTOR REINFORCEMENT (12" LONG)	ALUM-6063 T5	AT ASTRAGAL & INTERLOCK LOCATIONS
4	GW 37557	1	3 1/2" SILL	ALUM-6063 T6	FRAME BOTTOM
4A	TM-067	1	4 1/4" SILL	ALUM-6063 T6	FRAME BOTTOM
4B	TM-177	1	3 1/2" SILL	ALUM-6063 T6	FRAME BOTTOM
5	TM-095	1	DECORATIVE SILL COVER (OPTIONAL)	ALUM-6063 T5	FRAME BOTTOM
5A	TM-074	1	DECORATIVE SILL COVER (OPTIONAL)	ALUM-6063 T5	FRAME BOTTOM
8	GW 34977	2	FRAME JAMB (TWO TRACKS)	ALUM-6063 T6	FRAME SIDE
9	GW 37632	4	TOP RAIL	ALUM-6063 T6	PANEL TOP
10	GW 37624	4	BOTTOM RAIL	ALUM-6063 T6	PANEL BOTTOM
11	GW 37630	2	2"x4" MAJOR INTERLOCK	ALUM-6063 T6	PANEL SIDES
11A	GW 37630A	2	2"x4" MAJOR INTERLOCK	ALUM-6063 T6	PANEL SIDES
12	TM-065	2	2"x3" MAJOR INTERLOCK	ALUM-6063 T5	PANEL SIDES
15	GW 37625	2	MINOR INTERLOCK	ALUM-6063 T5	PANEL SIDES
15A	TM-106	2	MINOR INTERLOCK	ALUM-6063 T5	PANEL SIDES
16	GW 37623	1	MALE BUTT STILE	ALUM-6063 T6	PANEL ASTRAGAL
17	GW 37629	1	STILE ADAPTER	ALUM-6063 T5	PANEL ASTRAGAL
18	GW 37637	2	LOCK STILE	ALUM-6063 T6	PANEL SIDES
20	FXD 37743	2	BOTTOM CLIP (3 x 3 x 1/4 x 1 7/16" LG. ANGLE)	ALUMINUM	FRAME SILL
21	TP 37743	2	TOP CLIP (3 x 3 x 1/4 x 1 7/16" LG. ANGLE)	ALUMINUM	FRAME HEAD
22	-	3	3 1/4" X 1/2" X 1/8" X 12" LG. REINF. CHANNEL	ALUMINUM	ABOVE INTERLOCKS & ASTRAGAL STILES
23	-	1/MOV. PANEL	.820" X 1.435" X .060" THK. CHANNEL, FULL LENGTH	STEEL	IN BOTTOM RAIL
24	-	1/MOV. PANEL	.650" X 1.235" X .060" THK. CHANNEL, FULL LENGTH	STEEL	IN BOTTOM RAIL
28	WV-3033	AS REQ'D	BULB TYPE VINYL	VINYL	HEAD RECEPTOR
29	4020-PILE	SINGLE ROW	"ULTRAFAB" FIN SEAL WEATHERSTRIP	WOOL	TOP & BOTTOM RAILS
30	4037-PILE	2/ROWS	"ULTRAFAB" FIN SEAL WEATHERSTRIP	WOOL	INTERIOR INTERLOCKS STILES
31	4020-PILE	SINGLE ROW	"ULTRAFAB" FIN SEAL WEATHERSTRIP	WOOL	FRAME JAMB/ASTRAGAL
32	-	2	1/2" x 2" LONG SELF ADHESIVE PILE PAD	WOOL	AT FRAME SILL
33	-	1	7/8" x 3" LONG SELF ADHESIVE PILE PAD	WOOL	AT FRAME HEAD
35	TM-36205	2/ MOV. PANEL	TM TANDEM ROLLER ASSEMBLY	ALUMINUM/NYLON	BOTTOM ACTIVE PANELS
36	TM-32476	1/ MOV. DOOR	TM LATCH ASSEMBLY	ALUM/VINYL/STEEL	MALE ASTRAGAL
37	TM-32424	AS REQD.	TM KEEPER	ALUMINUM	FEMALE ASTRAGAL
38	-	2/ CORNER	#8 X 5/8" FH SMS - FRAME ASSEMBLY SCREWS	STEEL	-
39	-	2	#10 X 1/2" OH. SMS. - KEEPER INST. SCREW	STEEL	FEMALE ASTRAGAL
40	-	8/PANEL	#10 X 1" PH. SMS. - PANEL ASSEMBLY SCREW	STEEL	PANEL CORNERS
41	-	(2/CLIP)	#14 X 1-1/4" PH. SMS. - FIXED PANEL CLIP	STEEL	TOP/BOTTOM CLIPS/STILES
42	-	1/CLIP	#14 X 1-1/2" PH. SMS. -TOP FIXED CLIP	STEEL	HEAD TOP INTERLOCK
44	-	AS REQD.	1 1/2" x 2" x 1/8" REINF. TUBE, FULL LENGTH	ALUMINUM	AT EACH MINOR INTERLOCK
44A	TM-107	AS REQD.	1 1/4" x 1-5/8" REINF. TUBE, FULL LENGTH	ALUMINUM	AT EACH MINOR INTERLOCK
45	-	AS REQD.	1 1/2 x 2 x 1/8" REINF. TUBE, 10" LONG	ALUMINUM	-
48	-	6	#14 x 1" PH. SMS.	STEEL	AT 50" O.C. MAX. ABOVE INTERLOCKS
49	-	3	2 X 4 X 1/8" REINF. TUBE (LENGTH = PANEL HT. - 8")	ALUMINUM	MAJOR INTERLOCK/ASTRAGAL
50	-	AS REQ'D	SILICONE CAP	SILICONE	FRAME/HEAD RECEPTOR
51	-	2/LATCH	#10 X 2" OH. MS. - ASSEMBLY SCREW	STEEL	LATCH ASSEMBLY
53	-	4/CHANNEL	#14 X 1-1/2" PH. SMS.	STEEL	AT HEAD ALUM. CHANNEL

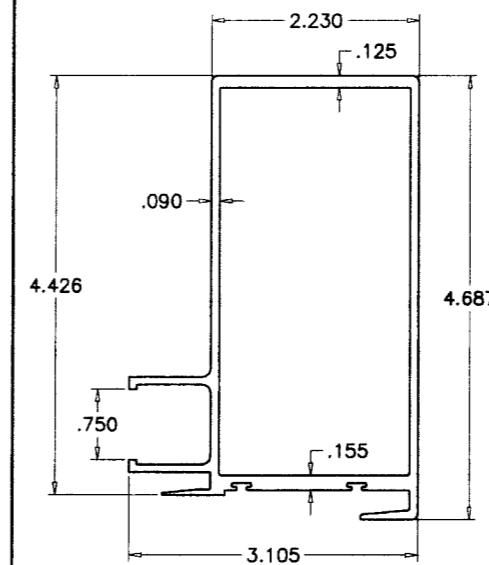

⑩ 2"x4" MAJOR INTERLOCK
GW 37630A (OPTIONAL)

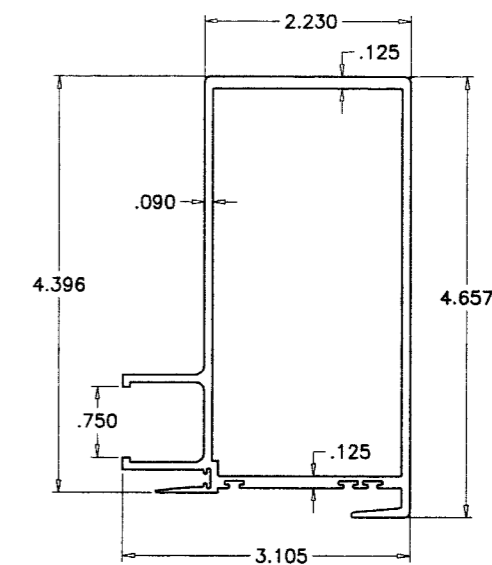

⑪ 2"x4" MAJOR INTERLOCK
GW 37630

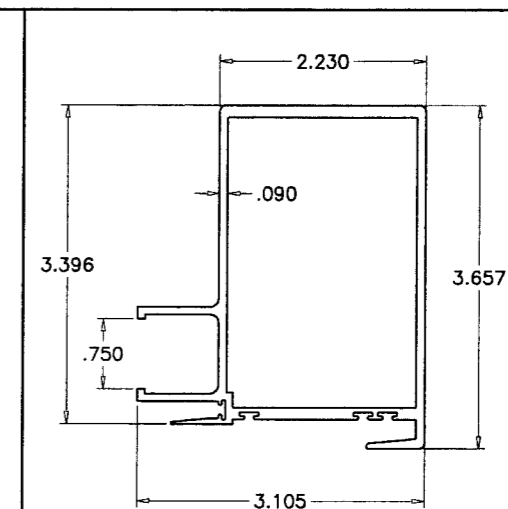

⑫ 2"x3" MAJOR INTERLOCK
TM-065

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **05-0617-03**
Expiration Date **JAN 23, 2013**

By **[Signature]**
Miami Dade Product Control
Division

LOCKS:

2 POINT FLUSH MOUNT HOOK LOCK AT MOVING PANEL LOCK STILE
42-1/2" FROM BOTTOM FASTENED WITH (2) #10 X 5/8" FH SMS.
(2) SURFACE MOUNT ALUMINUM KEEPERS FACING LOCK AT 35-1/2"
AND 50" FROM BOTTOM EACH FASTENED WITH (3) #12 X 2" FH SMS.

Engr: DR. HUMAYUN FAROOQ
STRUCTURES
FLA. PE # 18557
C.A.N. 3538

SEP 15 2008


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-87TMW

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
601 N.W. 12TH AVE.
POMPANO BEACH, FL. 33069
TEL. (954) 781-4430 FAX. (954) 781-5078


revisions:	no.	date	by	description
A	08.01.05			NO CHANGE THIS SHEET
B	04.15.08			GENERAL REVISION
C	08.28.08			REV. PER BCCO COMMENTS
D	09.12.08			NO CHANGE THIS SHEET

date: 09-25-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W02-87
sheet 9 of 10

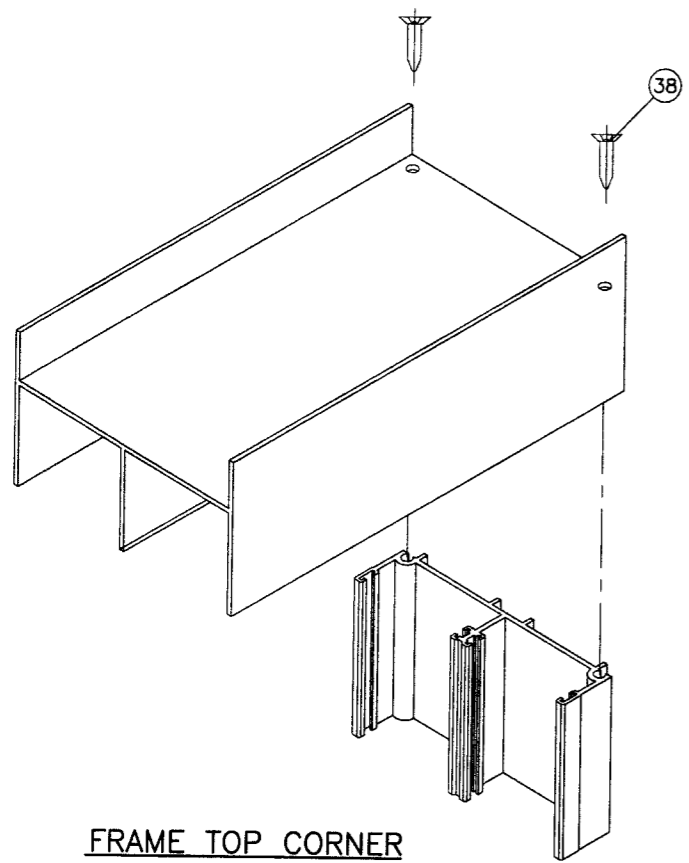


FRAME TOP CORNER

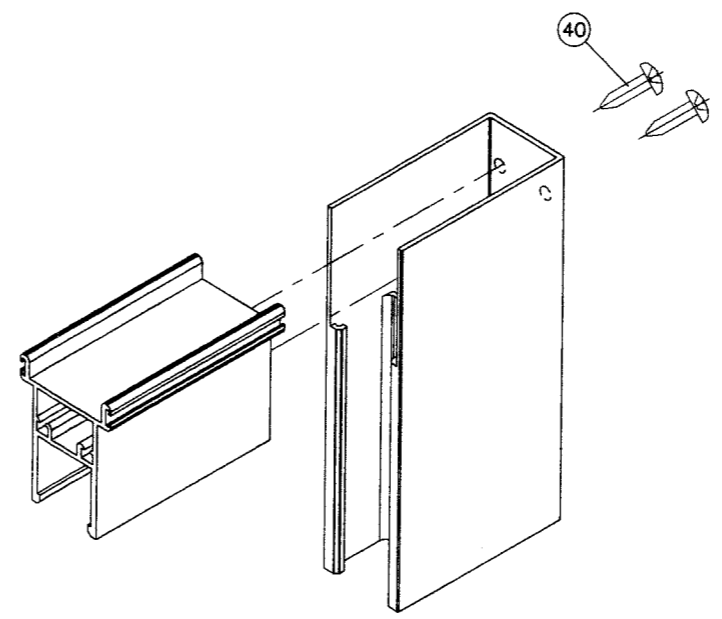

PANEL TOP CORNER

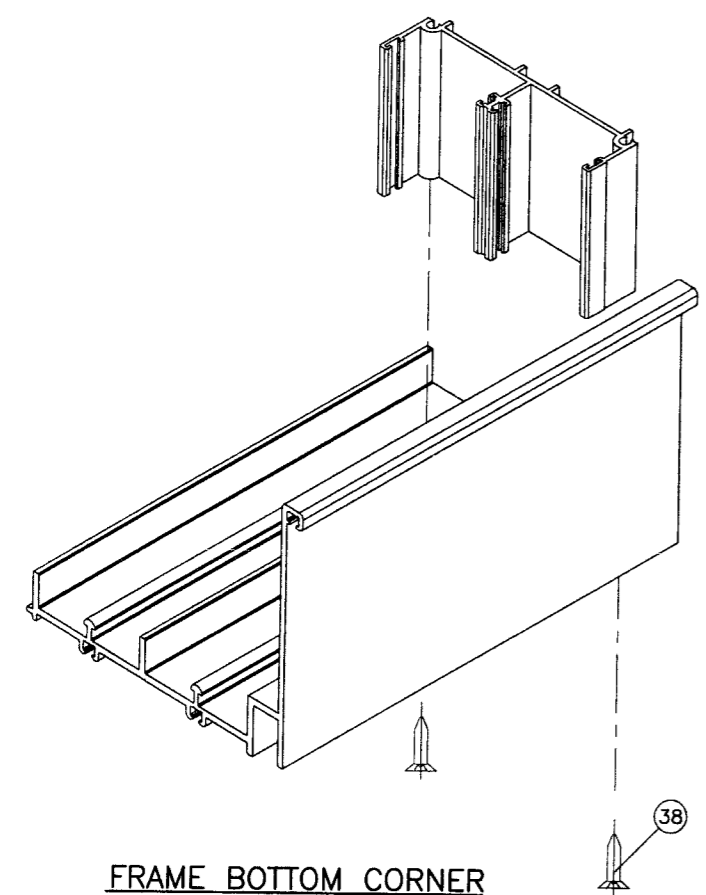

FRAME BOTTOM CORNER

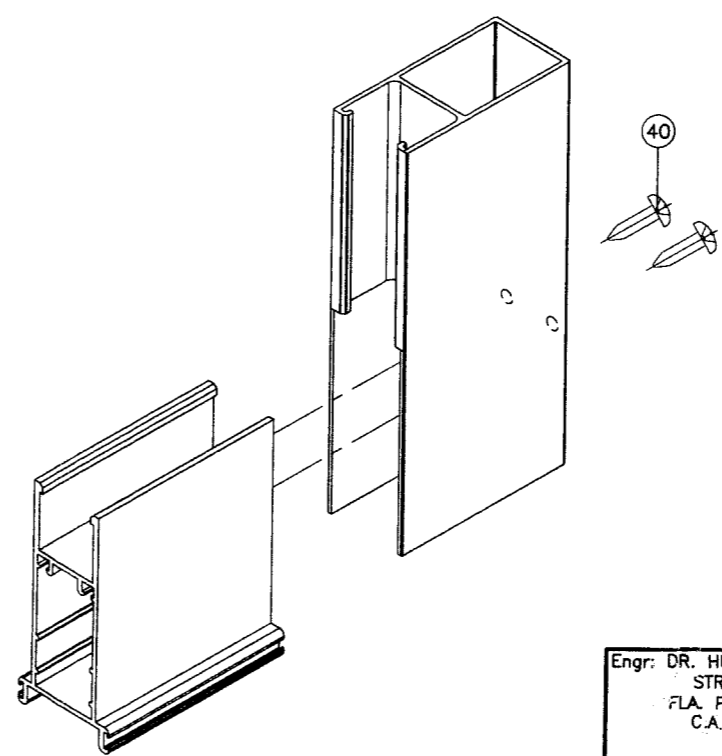

PANEL BOTTOM CORNER

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0617.03
 Expiration Date: JAN 23, 2013
 By: Shag I. Chande
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

~~SEP 15 2008~~

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-87TMW

SERIES-350 ALUM. SLIDING GLASS DOOR (L.M.I.)
TM WINDOW AND DOOR
 601 N.W. 12TH AVE.
 POMPANO BEACH, FL. 33069
 TEL. (954) 781-4430 FAX. (954) 781-5078

no	date	by	description
B	04.15.08		GENERAL REVISION
C	08.28.08		REV. PER BCCO COMMENTS
D	09.12.08		NO CHANGE THIS SHEET

date: 09-25-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-87